

TAMWORTH WATER QUALITY REPORT 2025



Jill Emerson, *Staff Scientist*

Cassidy Gersten, *AmeriCorps Water Quality Resource Assistant*

Turbidity

- Water clarity
- Determined by amount of suspended particles and sediment

pH

- Pure water has pH 7
- Most NH streams have pH 6.5
- Ideal range for aquatic organisms is 6.5-8.2

Dissolved Oxygen (DO)


- Measure of how much oxygen is available to aquatic species
- Different species need different amounts

Stream & Site Characteristics

- Substrate (i.e. river bottom)
- Weather
- Water scent & appearance
- General observations

Conductivity

- Ability of water to pass electrical charge
- Based on amount of charged compounds or ions (Na⁺, Cl⁻, NO₃⁻, etc.)
- Can be used to interpret amount of salt in water

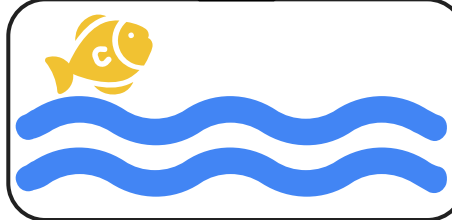

Temperature

Influences:

- Plant growth & animal activity
- DO levels
- Rate of chemical reactions

Phosphorus & Nitrogen

- Critical nutrient for plant and algae growth
- High levels indicate more decomposition (i.e. sewage) or human inputs (e.g. fertilizer runoff)

Dissolved Organic Carbon

- Occurs naturally from organic decomposition
- Elevated levels from runoff and sewage

Calcium

- Occurs naturally
- Essential for plants and animals
- Used to measure hardness

Sulfate

- Occurs naturally from weathering
- Elevated levels from mines, smelters, paper mills

Sodium

- Present in water in low concentrations, vary based on geology
- Elevated concentrations from road salt runoff

RIVERS Parameters

Magnesium

- Occurs naturally
- Essential nutrition for plants and animals
- Used to measure hardness

Chloride

- Present in water in low concentrations, vary based on geology
- Elevated concentrations from road salt runoff, sewage, or farming



Potassium

- Occurs naturally from weathering or plant decomposition
- Elevated levels from pollution, leaky septic tanks, fertilizer runoff

RIVERS Parameters - Water Quality Standards & Allowable Limits

Parameter	Limit/Standard
Conductivity	< 100 µg/cm
Turbidity	< 10 NTU
pH	6-8 preferably 6.5 in NH
Dissolved Oxygen (DO) & Percent DO	6-11 mg/L 75% - 120%
Temperature	No standard, monitored for major changes
Total Phosphorus (TP)	< 30 µg/L
Nitrogen	Variable

- Based on NHDES & EPA criteria
- Each site will vary in these values due to differences in surrounding plant life, land use, riverbed geology, infrastructure, etc.

Also measure temperature to visualize its relationship with DO, which should be **inverse** in a healthy stream (**as temp. increases, DO decreases**).

Dependent on what form of nitrogen is being tested.

RIVERS Parameters - Water Quality Standards & Allowable Limits

Parameter	Limit/Standard
Chloride	< 10 mg/L
Sodium	< 50 mg/L
Dissolved Organic Carbon	1-10 mg/L
Calcium	< 15 mg/L
Sulfate	< 80 mg/L
Magnesium	1-100 mg/L
Potassium	< 10 mg/L

- Based on NHDES & EPA criteria
- Each site will vary in these values due to differences in surrounding plant life, land use, riverbed geology, infrastructure, etc.

Bearcamp River (GT-1)

Data analyzed from May 2020 - Oct 2025


- Monitored since 2002
- Parameters measured: pH, turbidity, temperature, conductivity, DO, TP



Parameter	Status	Change
pH	Within ideal range	Small decrease from 2024
Turbidity	Within ideal range	Small decrease from 2024
Total Phosphorus*	Within ideal range	Small decrease from 2024


Conductivity

Conductivity steadily increased across the sampling period in 2025 unlike 2020-24. Values remained below 2020-24 values until Aug. All values fell within the ideal range.

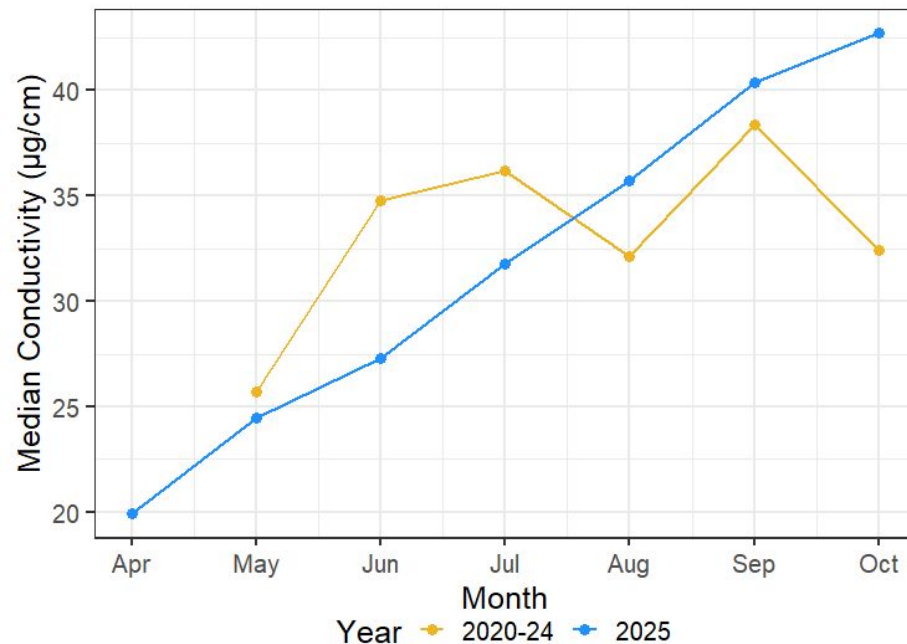


% Dissolved Oxygen

% DO values were higher in 2025 at the beginning of the sampling period compared to 2020-24 (May and Jun), and dipped below 2020-24 values at the end of the sampling period (Jul to Oct). All values fell within the ideal range.

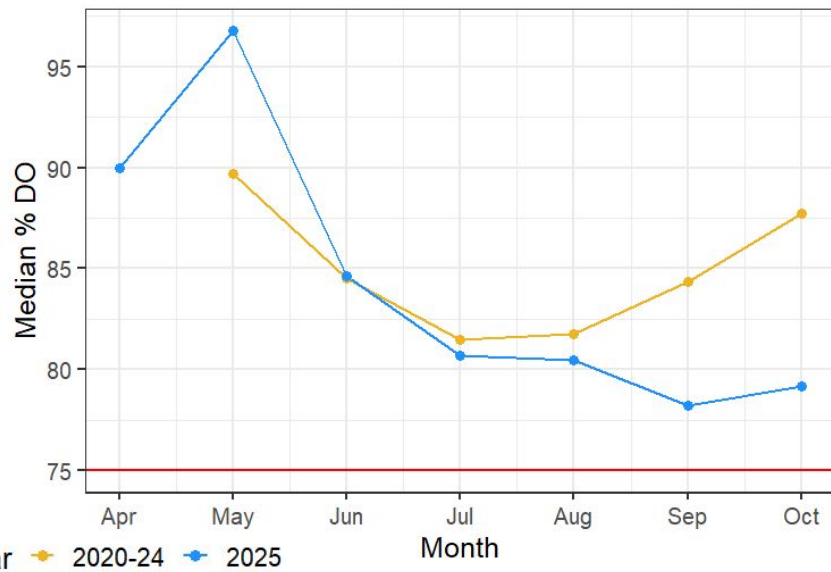

DO & Temperature

There is a consistent inverse relationship between parameters in 2020-24 and 2025. Values stayed within the ideal range in 2025.

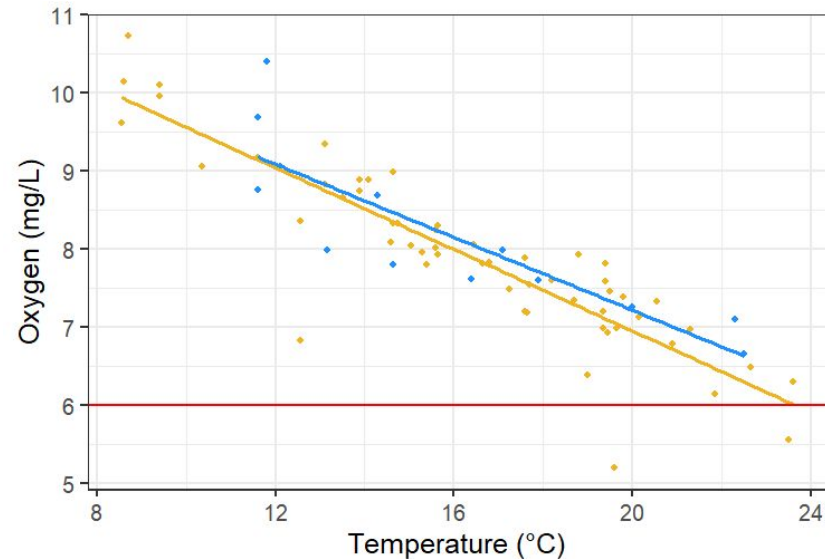

Chocorua River (GT-4)

Data analyzed from Jan 2020 - Dec 2025


- Monitored since 2004
- Parameters measured: pH, turbidity, temperature, conductivity, DO, TP, ions



Parameter	Status	Change
pH	Within ideal range	Small decrease from 2024
Turbidity	Within ideal range	Small decrease from 2024
Total Phosphorus*	Within ideal range	Small decrease from 2024

Conductivity

2025 values increased from Mar to Oct before decreasing, similar to 2020-24. Unlike 2020-24, conductivity exceeded the ideal range in Oct 2025. All other values fell within the ideal range.

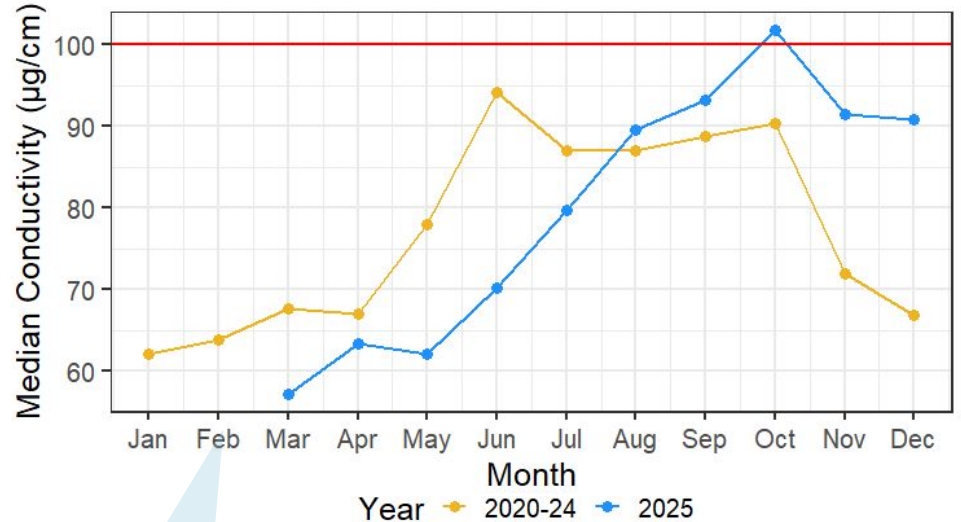


No samples taken because river was frozen over.

*values only available up to Nov 2025

% Dissolved Oxygen


% DO in 2025 generally followed the same trend as 2020-24, decreasing to a low in the summer before increasing from Sep to Dec. All values fell within the ideal range.

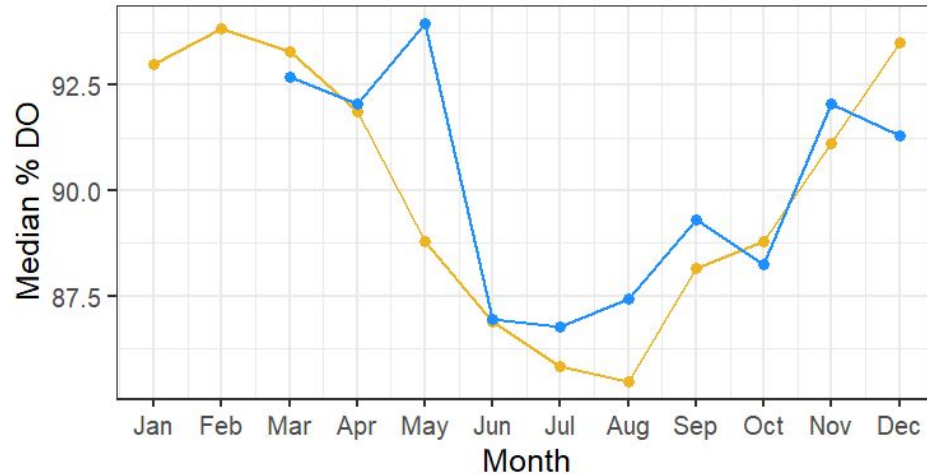

Year ◆ 2020-24 ● 2025

DO & Temperature

There is a slightly stronger inverse relationship between parameters in 2025 than in 2020-24. All 2025 values stayed within the ideal range.

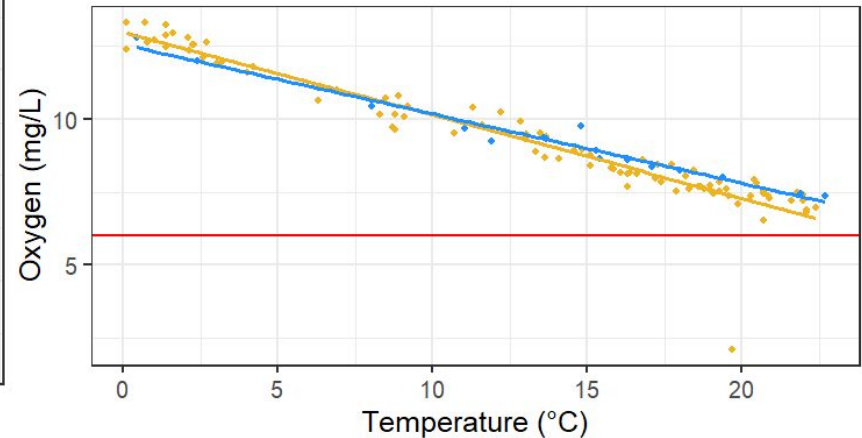


Parameter	Limit/Standard	Status
Ammonium	< 200 µg/L	In range
Orthophosphate	< 10 µg/L	Exceeded standard in Dec, Mar-Jun
Dissolved Organic Carbon	1-10 mg/L	In range
Total Dissolved Nitrogen	< 0.5 mg/L	Exceeded standard in Mar, Jul, Aug
Nitrate	< 0.05 mg/L	Exceeded standard in Aug-Dec 2024, Mar-Feb 2025, Jul-Aug 2025
Chloride	< 10 mg/L	Exceeded standard entire year
Sulfate	< 80 mg/L	In range
Sodium	< 50 mg/L	In range
Potassium	< 10 mg/L	In range
Magnesium	1-100 mg/L	Below 1 mg/L entire year
Calcium	< 15 mg/L	In range

Swift River (GT-5)

Data analyzed from May 2020 - Oct 2025


- Monitored since 2005
- Parameters measured: pH, turbidity, temperature, conductivity, DO, TP

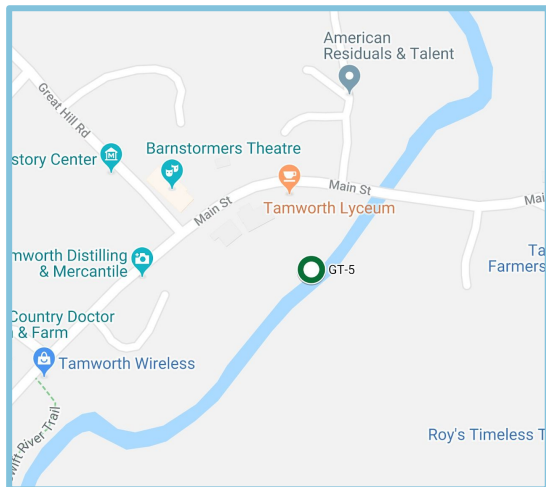

Parameter	Status	Change
pH	Within ideal range	Small decrease from 2024
Turbidity	Within ideal range	Small decrease from 2024
Total Phosphorus*	Within ideal range	Small decrease from 2024

Conductivity


Conductivity steadily increased over the sampling period in 2025 unlike 2020-24. 2025 values were lower than 2020-24 until Aug. All values were within the ideal range.

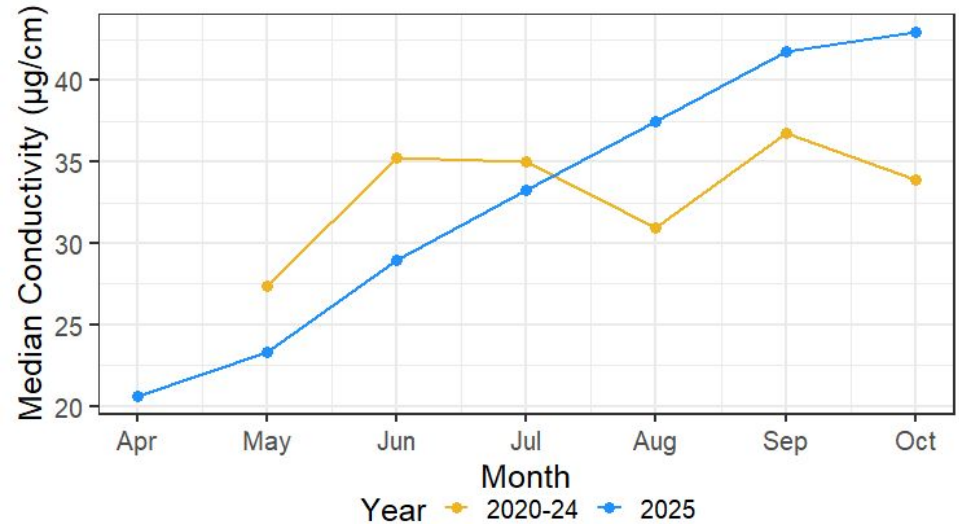

*values only available up to Nov 2025

% Dissolved Oxygen


% DO spiked in May 2025 before decreasing to consistent values throughout the rest of the sampling period, unlike 2020-24 which remained consistent. All values fell within the ideal range.

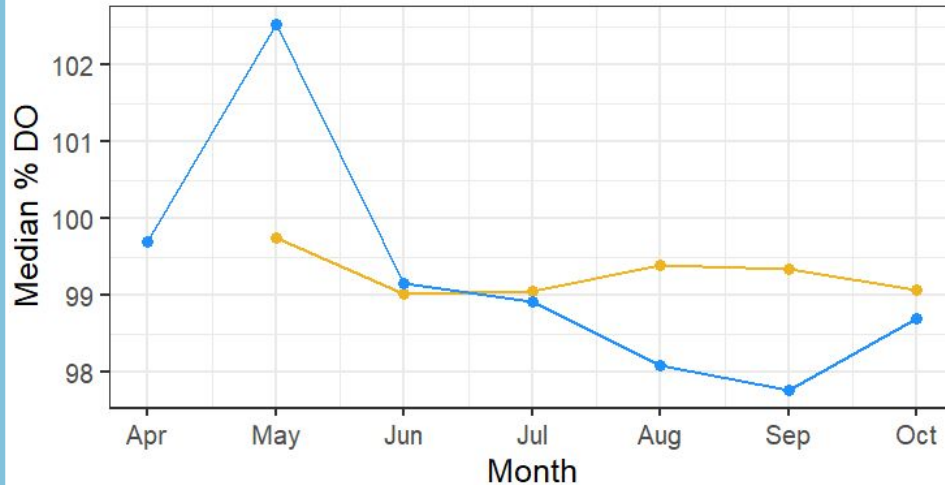

Year ● 2020-24 ● 2025

DO & Temperature

There is a slightly stronger inverse relationship between parameters in 2020-24 than in 2025. All values stayed within the ideal range.

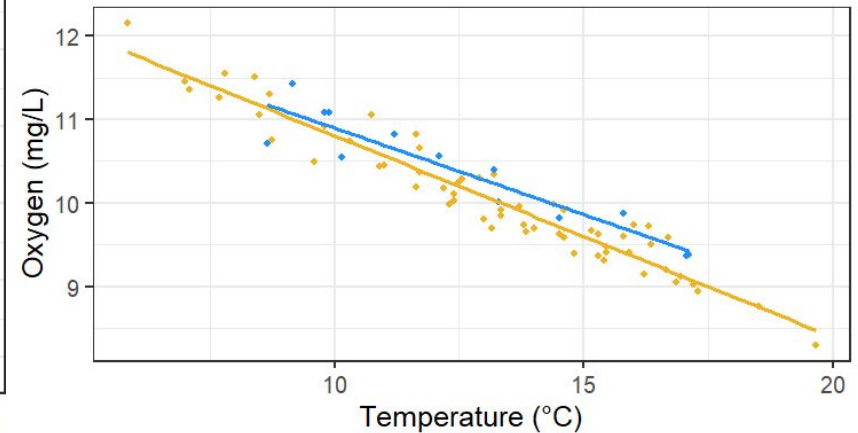

Overview of Findings

The majority of parameters tested fell within the acceptable limits for surface waters set by the New Hampshire Department of Environmental Services (NHDES) and/or the Environmental Protection Agency. Our findings do not indicate any trends or incidences of concern.

Parameter	Summary
Conductivity	Similar trend to previous years although with one unique high values outside the ideal range (site GT-4).
Turbidity	All sites exhibited small decrease in turbidity, within ideal range.
pH	All sites exhibited small decrease in pH, within ideal range.
% Dissolved Oxygen	Followed similar trends to previous years.
DO & Temperature	Consistent inverse relationships.
Total Phosphorus (TP)	All sites experienced a decrease in TP. All fell within ideal range.

What can Tamworth do to protect its water?

In Towns


- Monitor the effectiveness of culverts
- Work to replace culverts posing as safety and environmental hazards
- Maintain riparian areas (Streamside Management Zones) and monitor habitats near bodies of water for major changes

At Home

- Encourage residents to get their septic systems regularly checked and maintained
- Use Best Management practices (BMPs) for proper disposal of chemicals and waste materials

On Roads

- Reduce salt application on roadways, especially near bodies of water and sensitive habitats (e.g. wetlands)
- Consider **brining** – equally effective and more environmentally conscious method for keeping roads clear

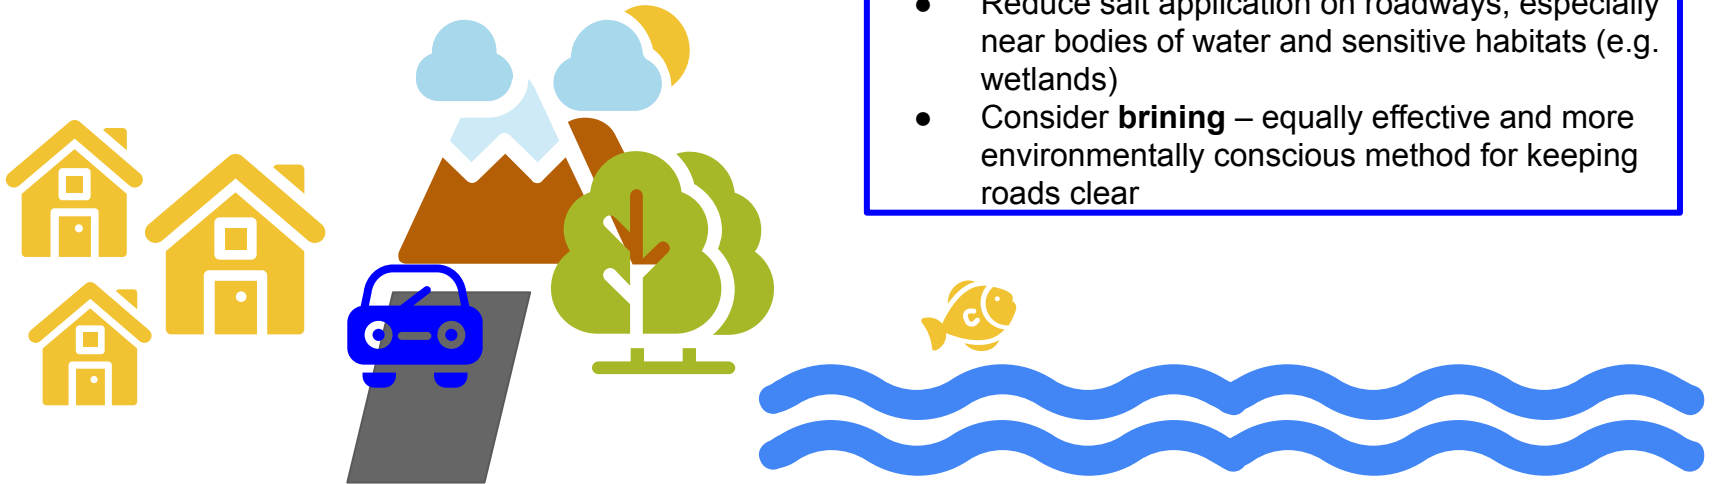

THANK YOU FOR YOUR TIME!

Report respectfully submitted by:

J. Emerson, *Staff Scientist*

C. Gersten, *Water Quality Resource Assistant*



AmeriCorps

